



PLAN VIEW

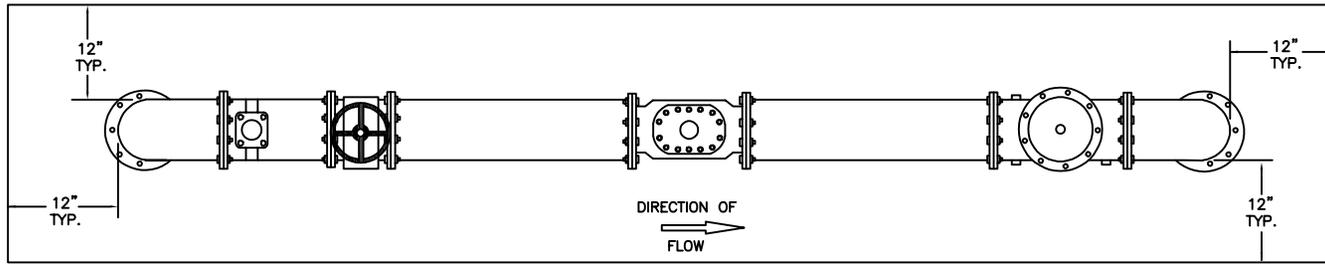


PROFILE VIEW

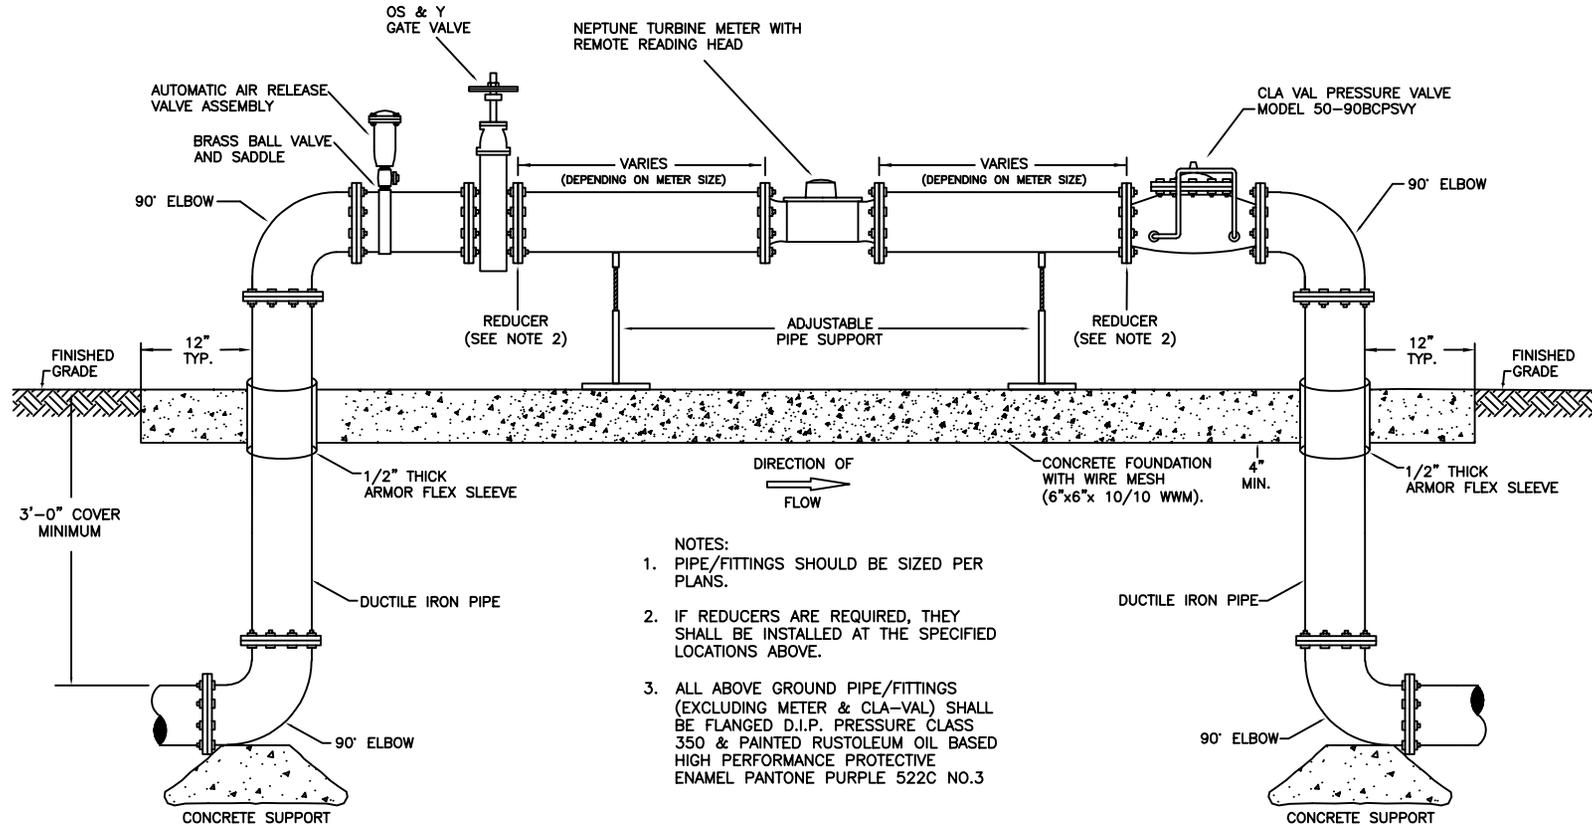

- NOTES:
1. PIPE/FITTINGS SHOULD BE SIZED PER PLANS.
 2. IF REDUCERS ARE REQUIRED, THEY SHALL BE INSTALLED AT THE SPECIFIED LOCATIONS ABOVE.
 3. ALL ABOVE GROUND PIPE/FITTINGS (EXCLUDING METER & CLA-VAL) SHALL BE FLANGED D.I.P. PRESSURE CLASS 350 & PAINTED RUSTOLEUM OIL BASED HIGH PERFORMANCE PROTECTIVE ENAMEL PANTONE PURPLE 522C NO.3

LAST REVISION	MAR 2025
CHECKED	MM
APPROVED	KRL

RECLAIMED WATER ABOVE GROUND METER ASSEMBLY



ENGLEWOOD WATER DISTRICT
201 SELMA AVENUE
ENGLEWOOD, FLORIDA 34223