


PLAN

MANHOLE BASE SLAB

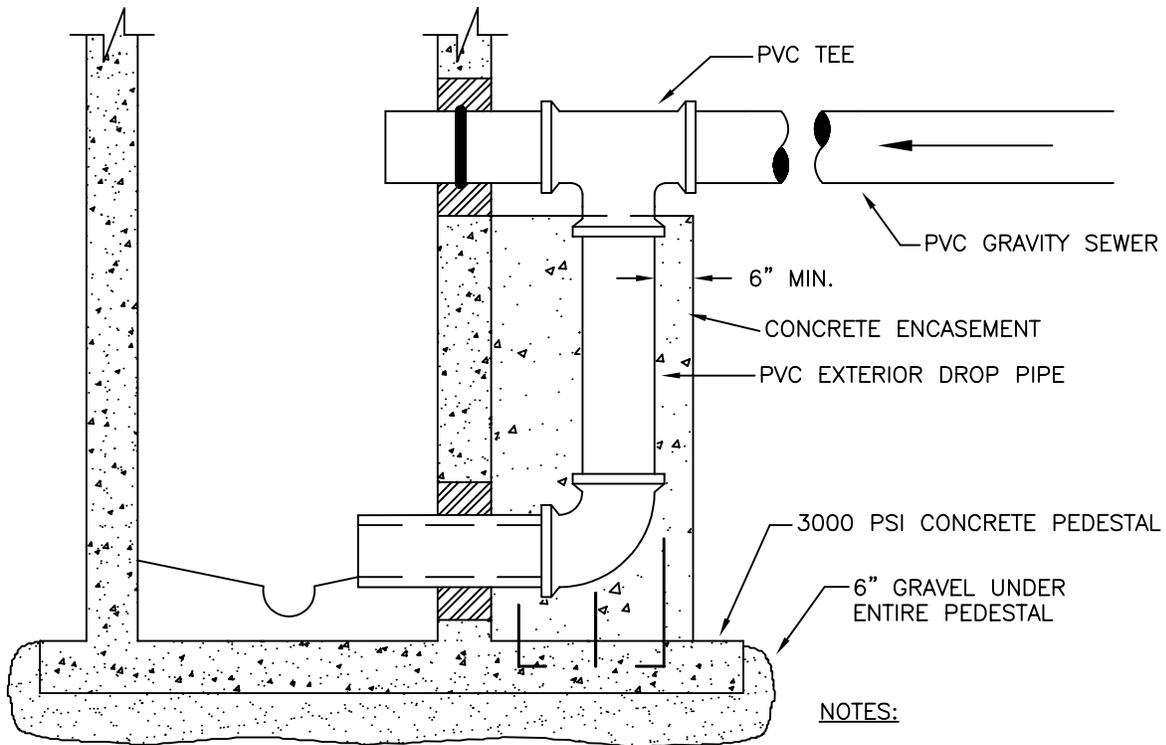

SECTION

NOTES:


1. MANHOLE TO BE CAST MONOLITHICALLY WITH EXTENDED SLAB TO SUPPORT CONCRETE ENCASEMENT OF BASE 90° FITTING. REINFORCING DOWELS SHALL EXTEND INTO CONCRETE FILL.
2. GRAVITY SEWER LINES ARE TO BE SDR-26 GREEN PVC.
3. INSIDE DROPS ARE NOT ACCEPTABLE.

LAST REVISION FEB 2026

CHECKED MM

APPROVED KRL

DROP MANHOLE



ENGLEWOOD WATER DISTRICT
201 SELMA AVENUE
ENGLEWOOD, FLORIDA 34223