

**PLAN**


\*\* SINGLE WYE TO BE INSTALLED IN DIRECTION TOWARD LOT IN WHICH IT SERVES (PER PLAN).

\* RISER PIPE TO BE LEFT 18" MIN. ABOVE GRADE DURING CONSTRUCTION PERIOD. AFTER FINISH GRADING IS COMPLETED, RISER SHALL BE CUT AND READJUSTED TO GRADE. WHERE CLEAN-OUT RISER FALLS IN A PAVED OR SIDEWALK AREA, A STEEL TRAFFIC BEARING CLEANOUT COVER SHALL BE USED.

**NOTE:**

EACH SERVICE OR DOUBLE WYE SERVICE SHALL HAVE A STUB-OUT BROUGHT TO THE PROPERTY LINE.

ALL PIPE TO BE SDR-26 PVC.

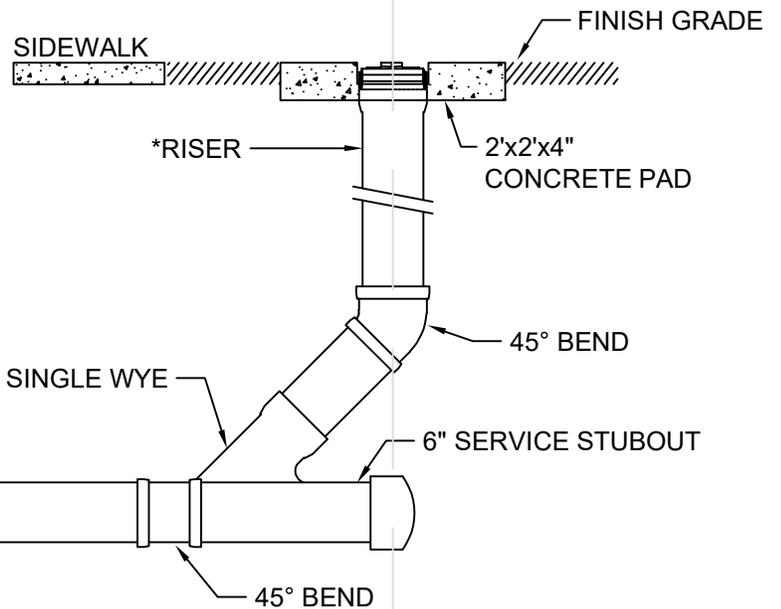


**SECTION**

LAST REVISION      APRIL 2024

CHECKED              MM

APPROVED            KRL

**SINGLE GRAVITY  
SEWER SERVICE**



**ENGLEWOOD WATER DISTRICT**  
201 SELMA AVENUE  
ENGLEWOOD, FLORIDA 34223