




PLAN VIEW

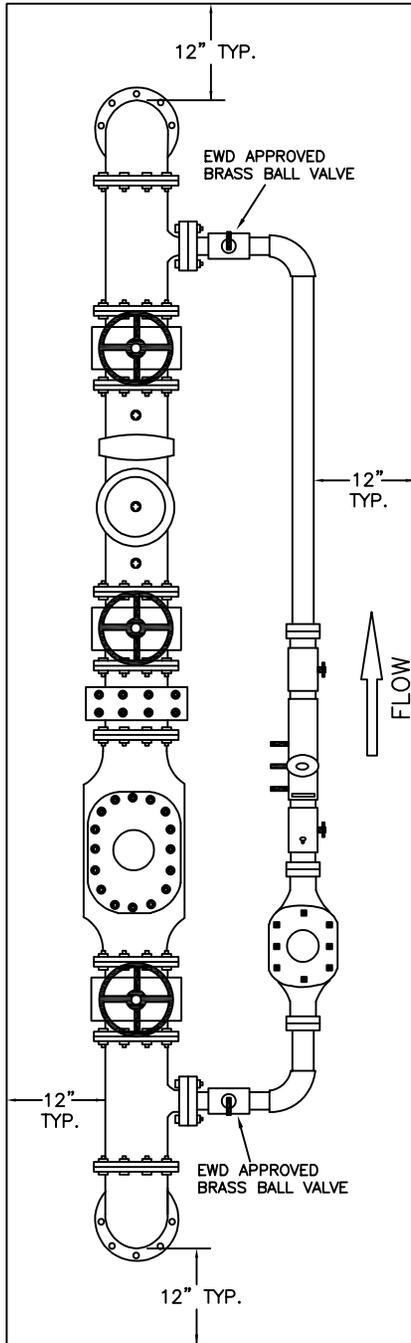

BYPASS ASSEMBLY PROFILE

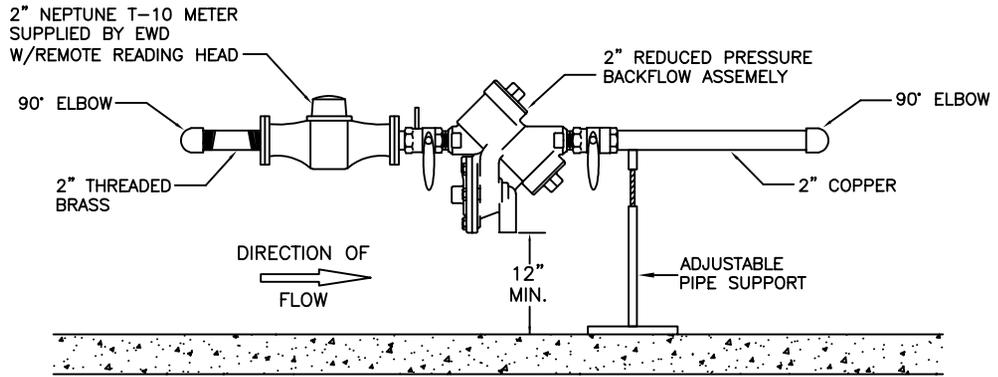


MAIN ASSEMBLY PROFILE

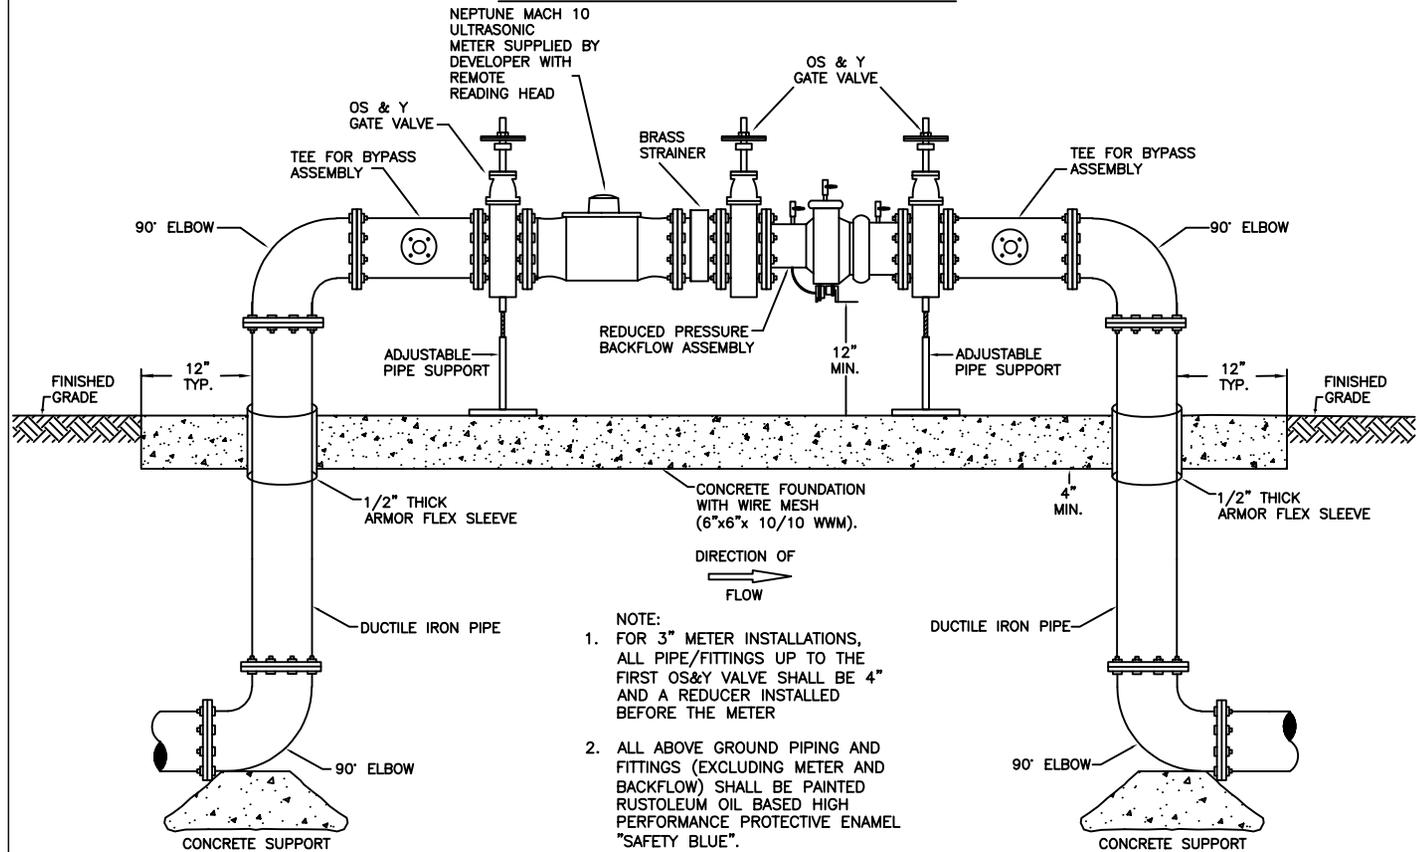

- NOTE:
- FOR 3" METER INSTALLATIONS, ALL PIPE/FITTINGS UP TO THE FIRST OS&Y VALVE SHALL BE 4" AND A REDUCER INSTALLED BEFORE THE METER
 - ALL ABOVE GROUND PIPING AND FITTINGS (EXCLUDING METER AND BACKFLOW) SHALL BE PAINTED RUSTOLEUM OIL BASED HIGH PERFORMANCE PROTECTIVE ENAMEL "SAFETY BLUE".

LAST REVISION	APRIL 2024
CHECKED	MM
APPROVED	KRL

3" AND GREATER ABOVE GROUND METER ASSEMBLY WITH BYPASS



ENGLEWOOD WATER DISTRICT
 201 SELMA AVENUE
 ENGLEWOOD, FLORIDA 34223