



NOTE:

RESTRAIN UPSTREAM PIPING PER RESTRAINT TABLE

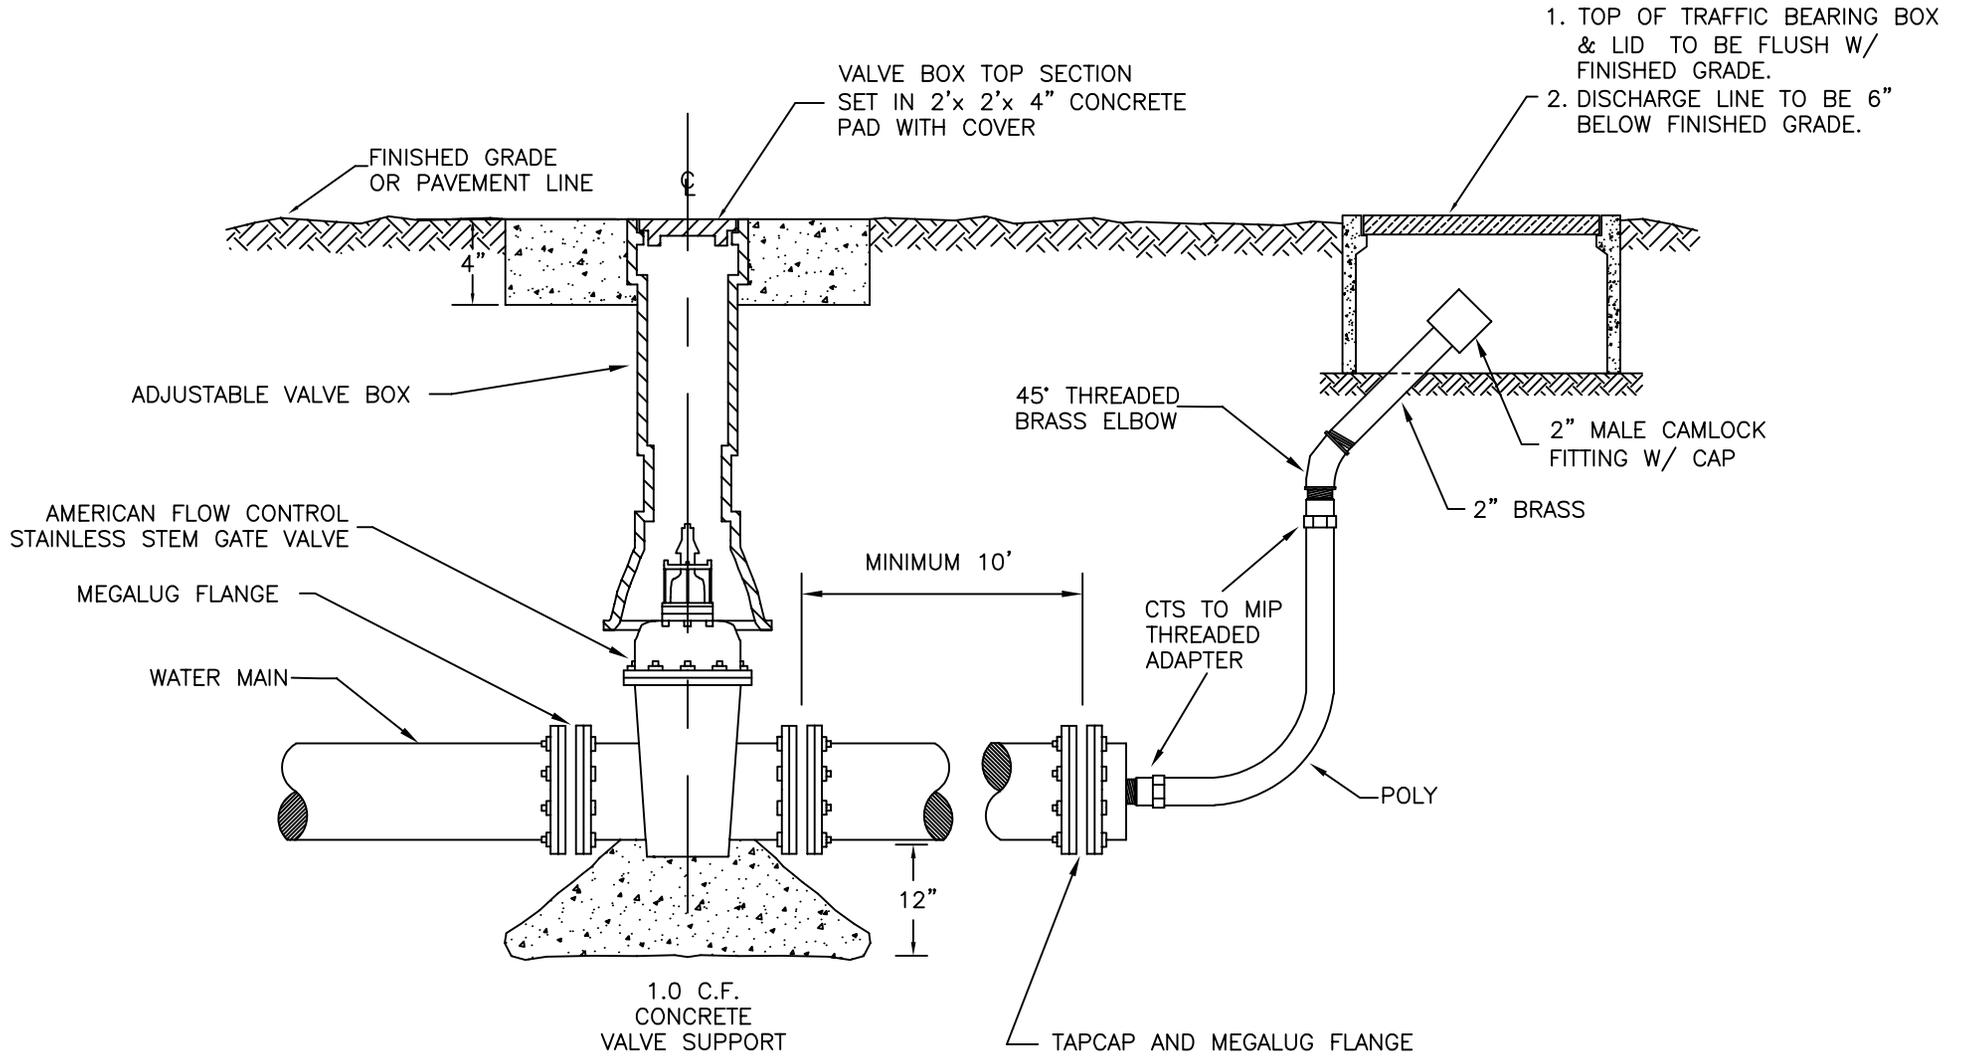

LAST REVISION	APRIL 2024
CHECKED	MM
APPROVED	KRL

TEMPORARY BLOWOFF ASSEMBLY



ENGLEWOOD WATER DISTRICT
 201 SELMA AVENUE
 ENGLEWOOD, FLORIDA 34223