



NOTE:

- 1. SIZE ACCORDINGLY
- 2. N.T.S.

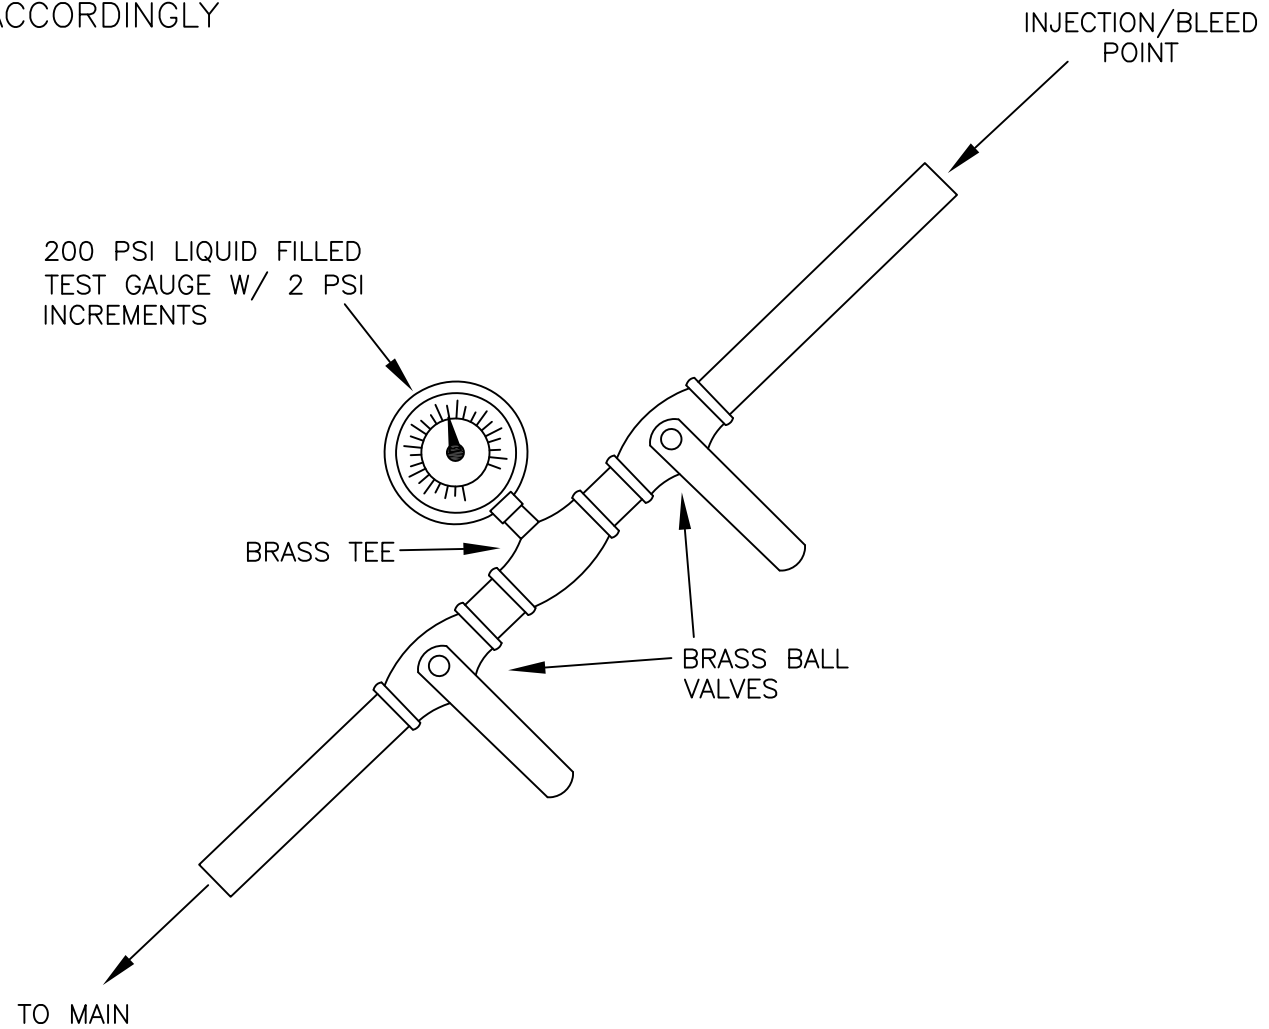

LAST REVISION	OCT. 2020
CHECKED	MM
APPROVED	KRL

PRESSURE TEST GAUGE ASSEMBLY

	ENGLEWOOD WATER DISTRICT 201 SELMA AVENUE ENGLEWOOD, FLORIDA 34223
---	---