



NOTES:

1. PIPE AND FITTING CONNECTING TO THE METER SHALL BE THE SAME DIAMETER. USE ADAPTERS AS REQUIRED TO MAKE CONNECTIONS.
2. PRESSURE RELIEF VALVE MAY BE REQUIRED DOWNSTREAM OF THE BACKFLOW PREVENTION ASSEMBLY.

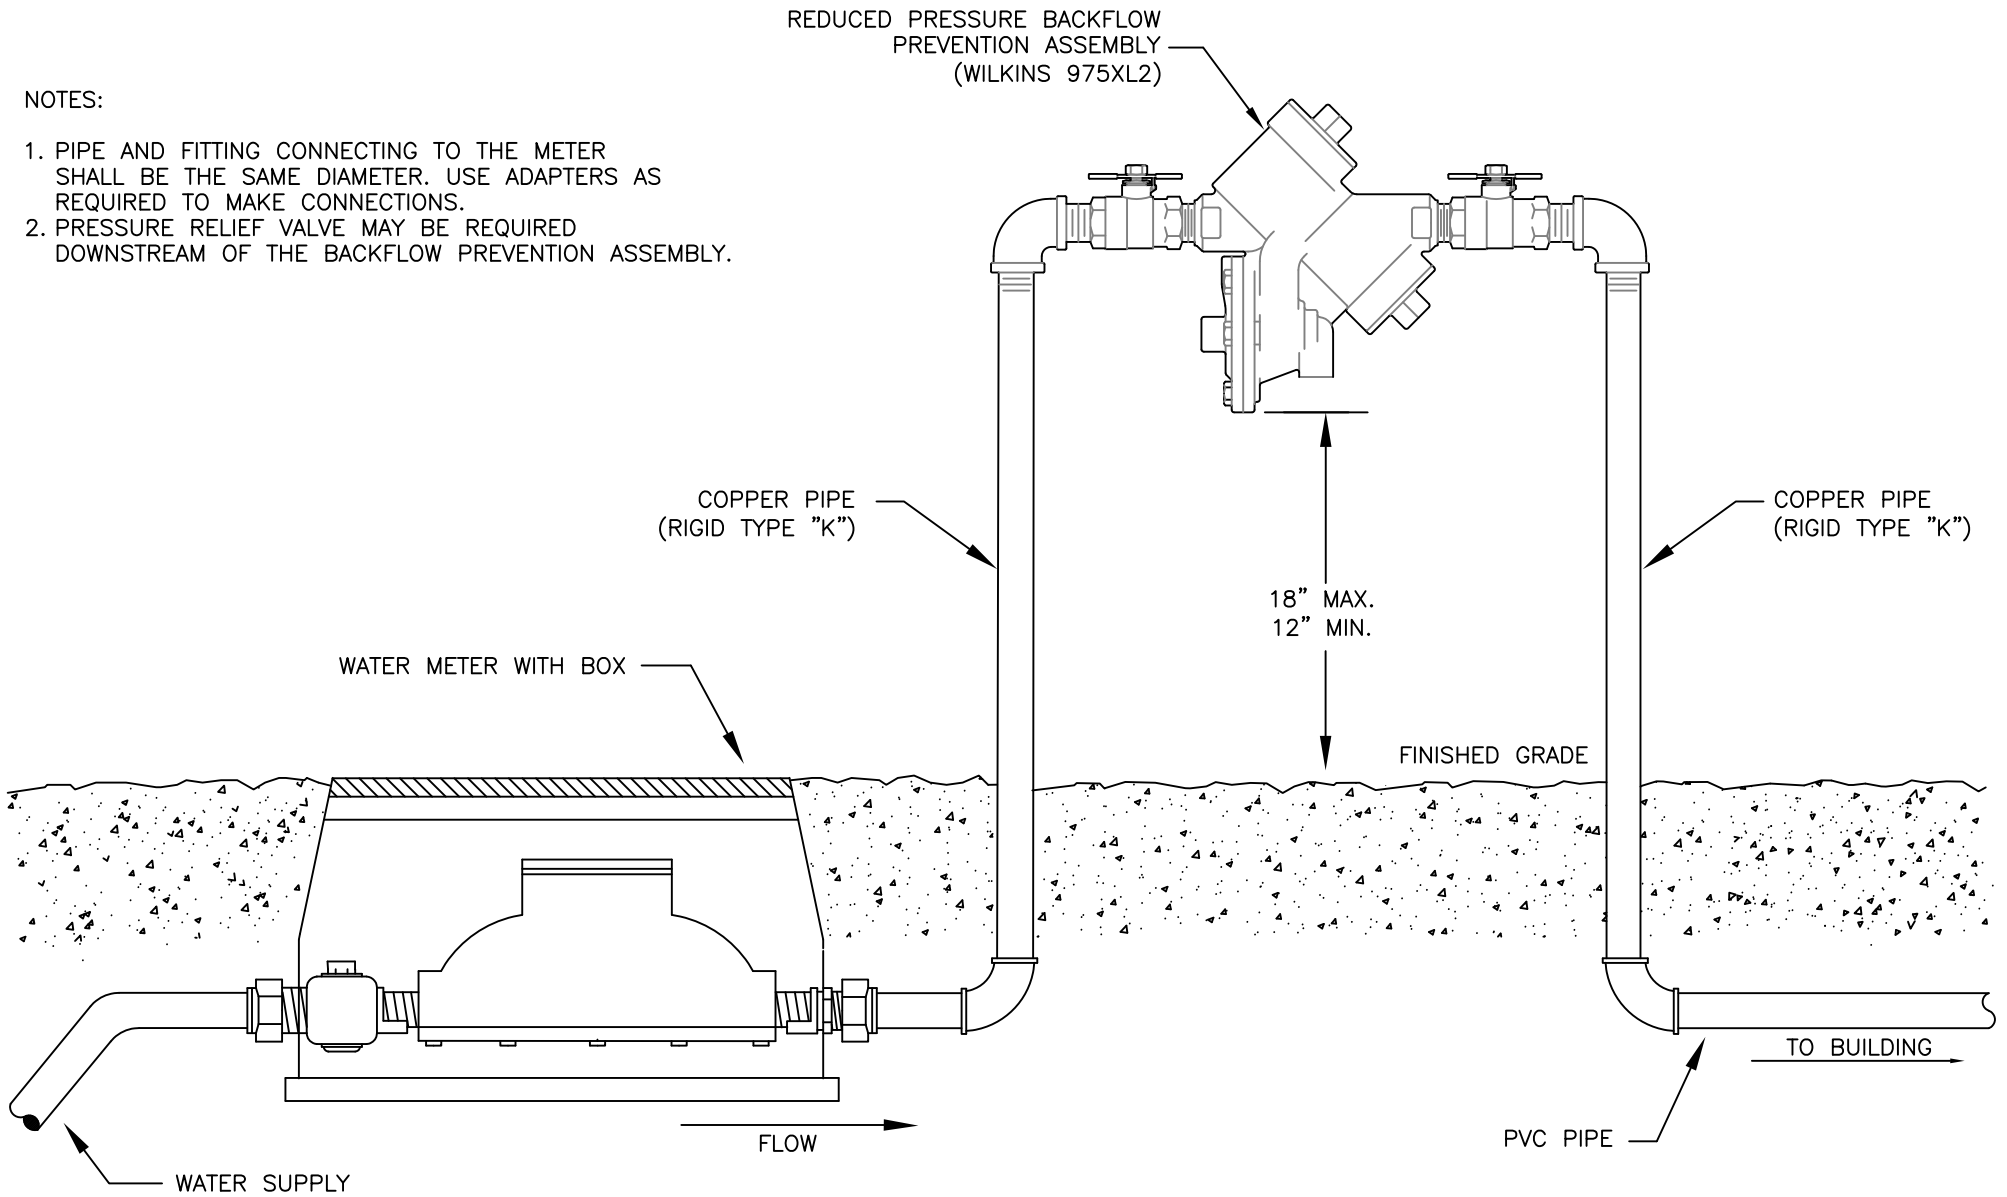

LAST REVISION	FEB. 2019
CHECKED	MM
APPROVED	KRL

**BACKFLOW  
PREVENTION ASSEMBLY**



**ENGLEWOOD WATER DISTRICT**  
 201 SELMA AVENUE  
 ENGLEWOOD, FLORIDA 34223