



NOTES:

- 1. RESTRAIN UPSTREAM PIPING PER RESTRAINT TABLE
- * VALVE BOX CENTER SECTION AS REQUIRED
- ** UTILITY APPROVED GATE VALVE
- *** IF SAMPLE POINT ASSEMBLY IS NEEDED, REFER TO SAMPLE POINT DETAIL

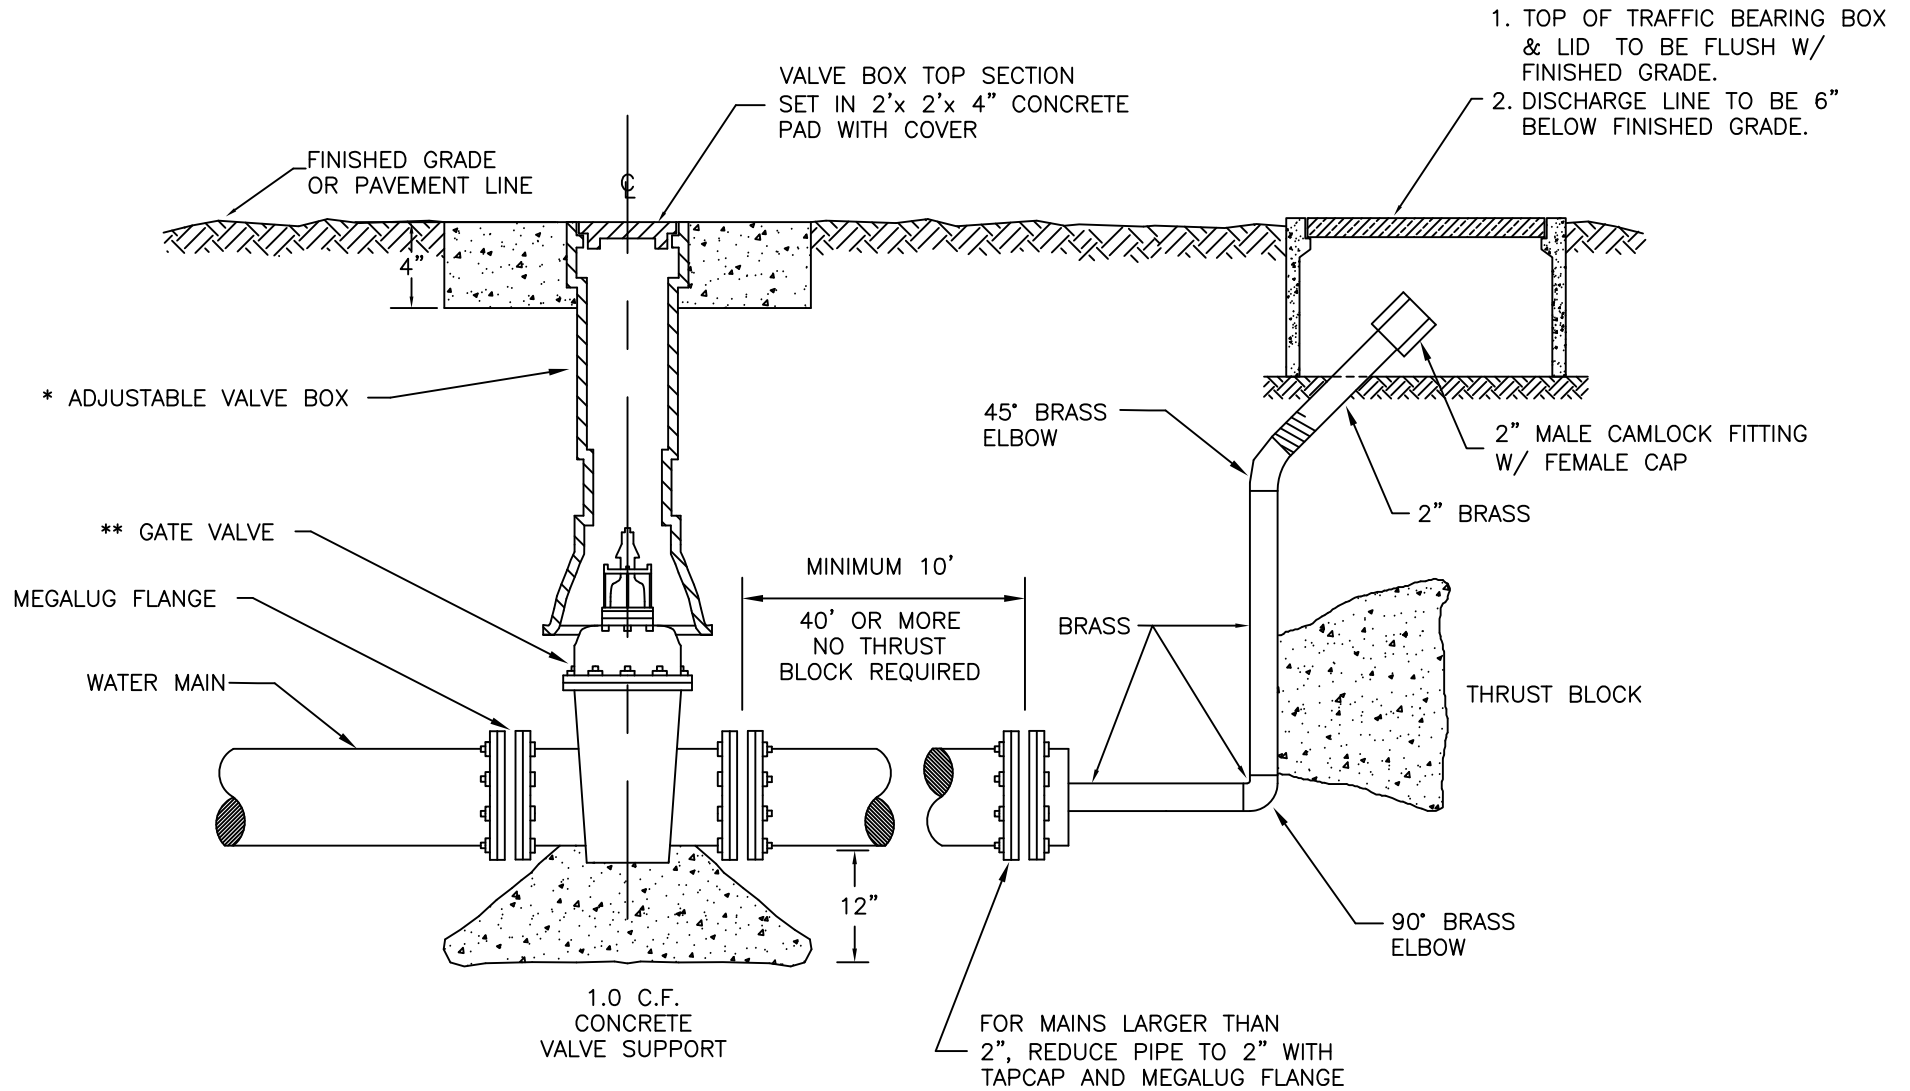

LAST REVISION	AUG. 2019
CHECKED	MM
APPROVED	KRL

**DEAD END BLOWOFF ASSEMBLY
WITH POSSIBLE EXTENSION**



ENGLEWOOD WATER DISTRICT
201 SELMA AVENUE
ENGLEWOOD, FLORIDA 34223